


Diagram 3 A


100 Amp Farm Service To 2 Buildings With Different Amperages Option #1

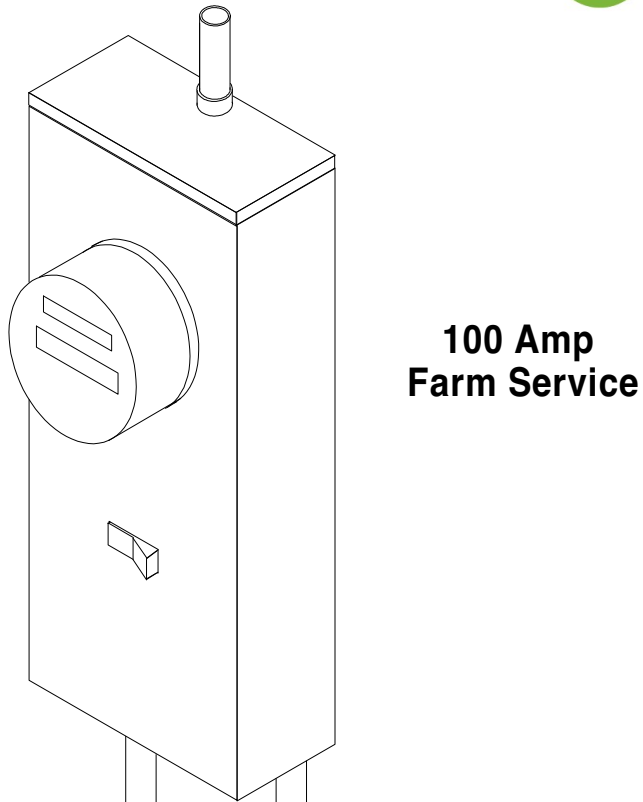

100 Amp
Farm Service

5 m Minimum From
Fortis Pole

60 Amp Fusible Disconnect can be
eliminated if panel in building #2
has a 60 Amp Main Breaker

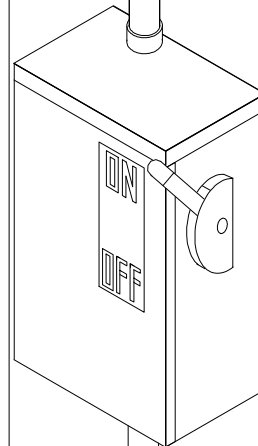

60 Amp

To Building #1
100 Amp

To Building #2
60 Amp