


Underground Gas & Electrical Same Trench

FOR TRENCHES
4" TO 11"
WIDE

FOR TRENCHES
12" TO 30"
WIDE

FOR TRENCHES
36" WIDE

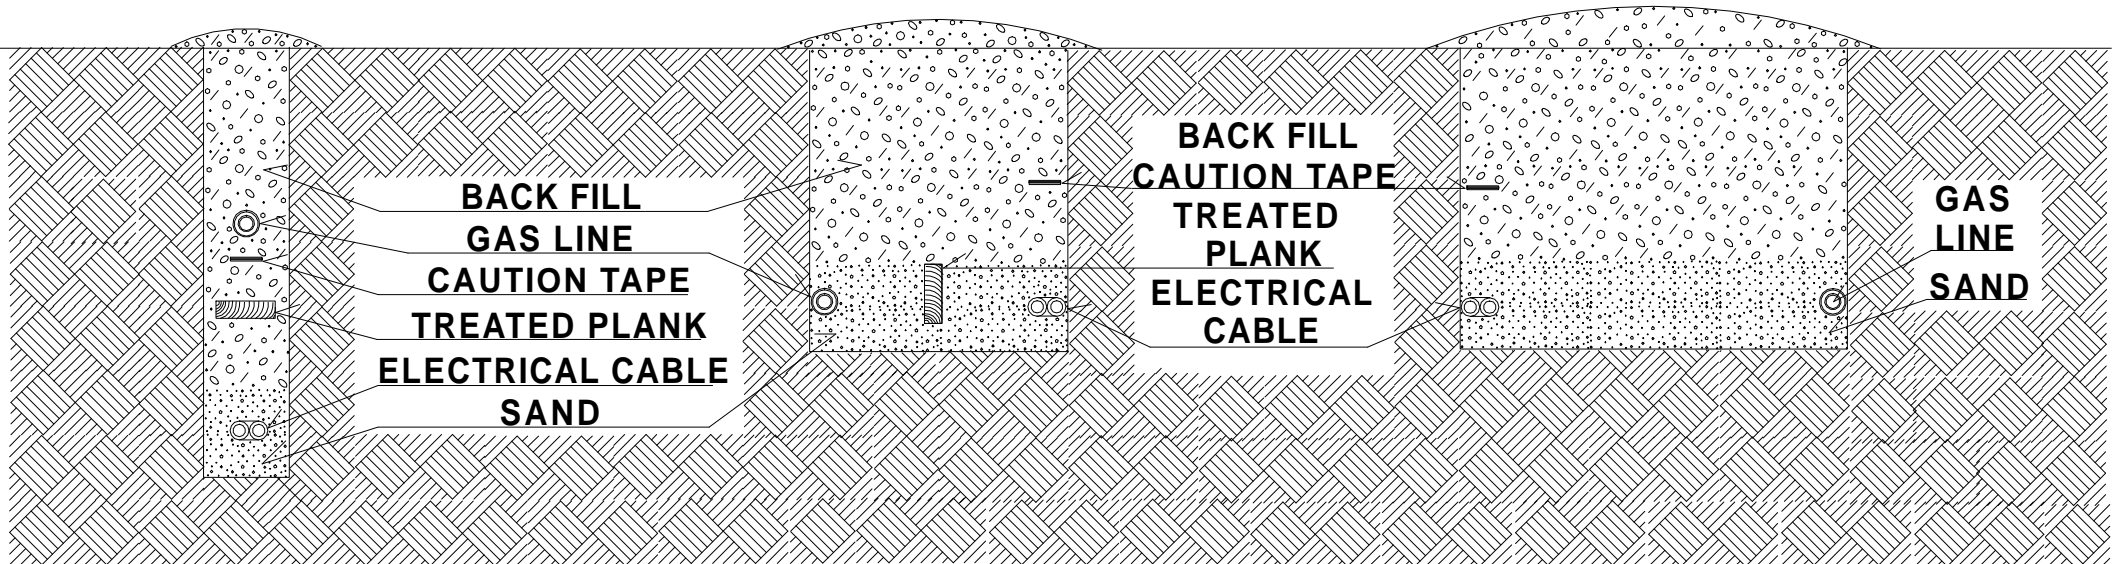

**GAS LINE DEPTH: 24 INCHES UNDER DRIVEWAYS AND PARKING AREAS,
15 INCHES UNDER NON TRAFFIC AREAS.**

**GAS LINE TO BE BURIED WITH A CONTINUOUS TRACER WIRE FROM RISER TO RISER
TERMINATING ABOVE FINISHED GRADE.**

**ELECTRICAL CABLE DEPTH: 36 INCHES UNDER DRIVEWAYS AND PARKING AREAS,
24 INCHES UNDER NON TRAFFIC AREAS.**

ELECTRICAL CABLE TO BE BURIED IN SAND 3 INCHES BELOW AND 3 INCHES ABOVE.

STANDATA CEC-6 (rev 6)

Gas sub-surface lines (ie., house to garage) are an owner responsibility under the Gas Code regulation and when electrical conductors are installed in the same trench, it is recommended that the two systems be separated by 12 inches of well tamped earth or a treated plank.